

Installation Instructions / Notice de montage



WARNING
ELECTRICAL SHOCK HAZARD

AVERTISSEMENT
RISQUE D'ÉLECTROCUTION

READ and UNDERSTAND these instructions before installing the luminaire.

LISEZ cette notice et assurez-vous de la **COMPRENDRE** avant de monter le luminaire.

EN Disconnect the Electrical supply power at the services panel (fuse or circuit breaker box). Failure to do so could result in serious injury. Consult a qualified electrician to ensure correct branch circuit conductor. The product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.

FR Couper l'alimentation du courant électrique au panneau de service (boîte de fusible ou disjoncteur) sans quoi il pourrait en résulter des blessures sérieuses. Consulter un électricien qualifié pour vous assurer que les conducteurs de la dérivation sont adéquats. Ce produit doit être installé selon le code d'installation pertinent, par une personne qui connaît bien le produit et son fonctionnement ainsi que les risques inhérents.

INSTALLATION (Fig. 1)

Wall mounting, direct mounting to recessed junction box

1. Remove the front lens by unscrewing the four screws.
2. Remove the reflector by unscrewing the two screws.
3. For wall mounting, the unit is supplied with universal spider knockouts and keyhole slots stamped into the back housing. Knock out the appropriate holes for wires and mounting screws. Bring the electrical wires through the central hole outside the unit.
4. Paste the gasket on the back of the luminaire housing (make sure that all the gasket holes are aligned with the back housing knockouts).
5. Place the rear of the housing to recessed junction box.
6. Make the electrical connections between the power leads (black, white and green) and luminaire leads using the wire nuts. Push the wires into junction box.

NOTE: If photocell is not required:

- a. Unscrew the photocell.
 - b. Disconnect the quick connector (Fig. 1, detail).
 - c. Re-screw the photocell to the housing.
7. Fasten the rear of the housing to the wall using the two mounting screws while levelling the product. Secure the luminaire into place.
 8. Install the reflector using the two screws.
 9. Reinstall the front lens using the four screws.
 10. Caulk the entire perimeter of the luminaire to the mounting surface.
 11. Apply power.

WIRING

LED units are multi-volt 120V-277V (photocell 120-277 V standard).

TROUBLE SHOOTING CHECKLIST: If the light does not work.

Check your power source, check electrical connections.

INSTALLATION (Fig. 1)

Montage mural, direct à une boîte de jonction encastrée

1. Enlever la lentille avant en dévissant les quatre vis.
2. Enlever le réflecteur en dévissant les deux vis.
3. Pour le montage sur le mur, l'unité offre des débouchures de distribution universelles et des fentes estampées au dos du boîtier. Défoncer les trous appropriés pour le filage et les vis de montage.

Faire traverser les fils électriques par le trou central à l'extérieur de l'unité.

4. Coller le joint d'étanchéité sur l'arrière du boîtier du luminaire (assurez-vous que tous les trous du joint d'étanchéité sont alignés avec les débouchures du boîtier arrière).
5. Positionner l'arrière du boîtier sur la boîte de jonction encastrée.
6. Effectuez les connexions électriques entre les fils d'alimentation (noir, blanc et vert) et les fils du luminaire en utilisant des marettes. Poussez les fils dans la boîte de jonction.

NOTE: Si la cellule photoélectrique n'est pas requise:

- a. Dévisser la cellule photoélectrique.
 - b. Débrancher le connecteur rapide (Fig. 1 détail).
 - c. Revisser la cellule photoélectrique dans le boîtier.
7. Serrer l'arrière du boîtier contre le mur à l'aide des deux vis de fixation lors de la mise à niveau du produit. Fixer le luminaire en place.
 8. Installer le réflecteur en utilisant les deux vis.
 9. Réinstaller la lentille avant en utilisant les quatre vis.
 10. Appliquer un produit de calfatage sur tout le périmètre entre le luminaire et la surface de montage.
 11. Mettre sous tension.

CÂBLAGE

Les unités DEL sont à tension multiple 120 V–277 V (cellule photo-électrique standard 120-277 V).

DÉPANNAGE - LISTE DE VÉRIFICATIONS : Si la lumière ne s'allume pas.

Vérifier la source d'alimentation de l'installation, vérifier tout le raccordement électrique.

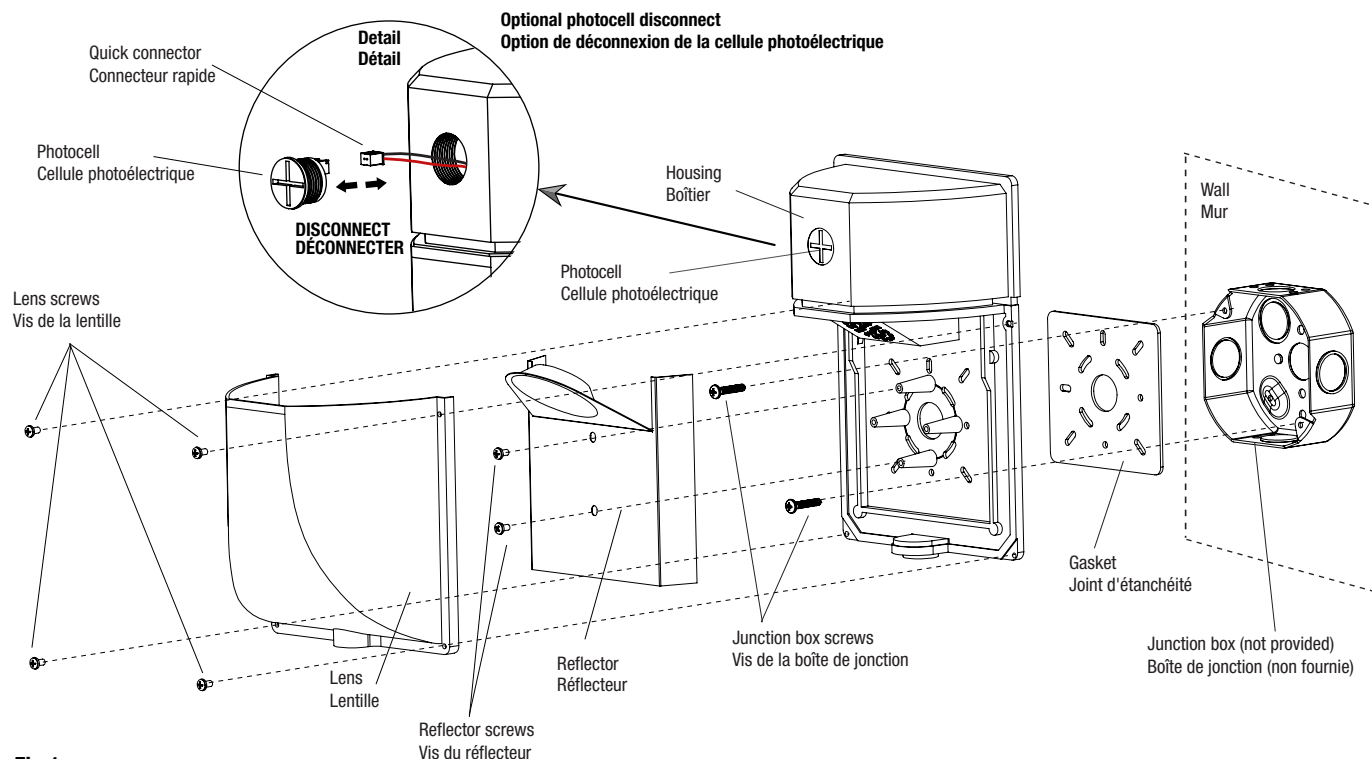


Fig.1