
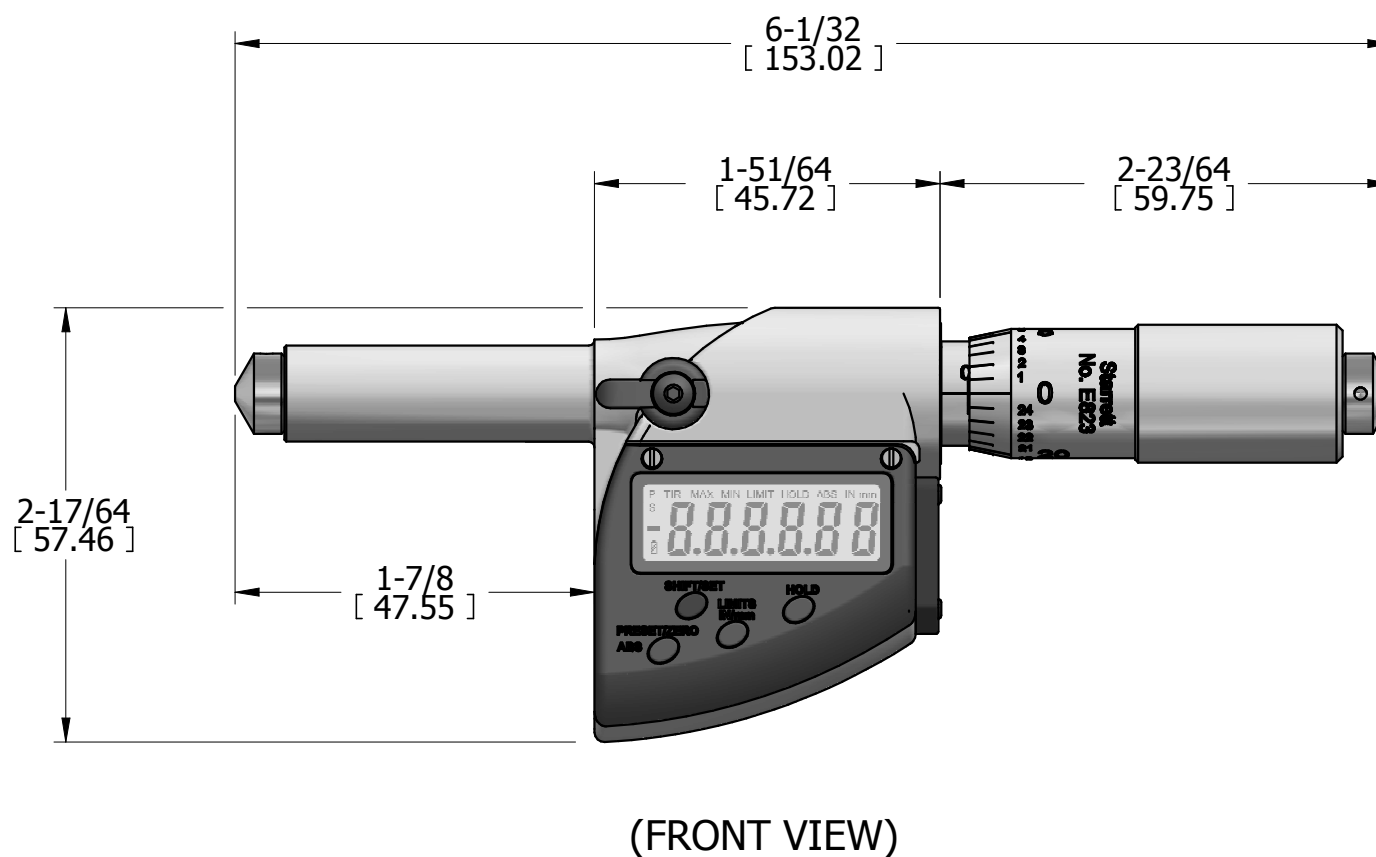


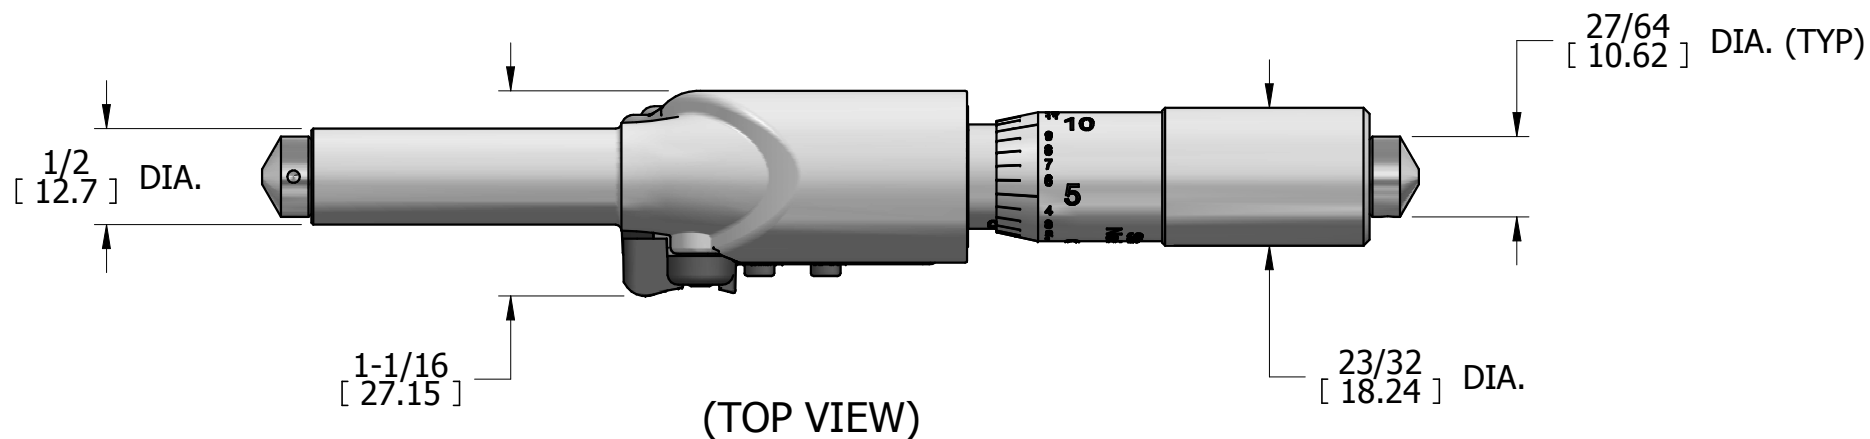


REV	DESCRIPTION	DATE	BY
DR	SMB	CHK	DATE 10/29/15

ELECTRONIC INSIDE
MICROMETER W/OUTPUT

THE L.S. STARRETT CO.
ATHOL, MASS.

FRACTIONAL TOLERANCE $\pm 1/64$ UNLESS OTHERWISE NOTED

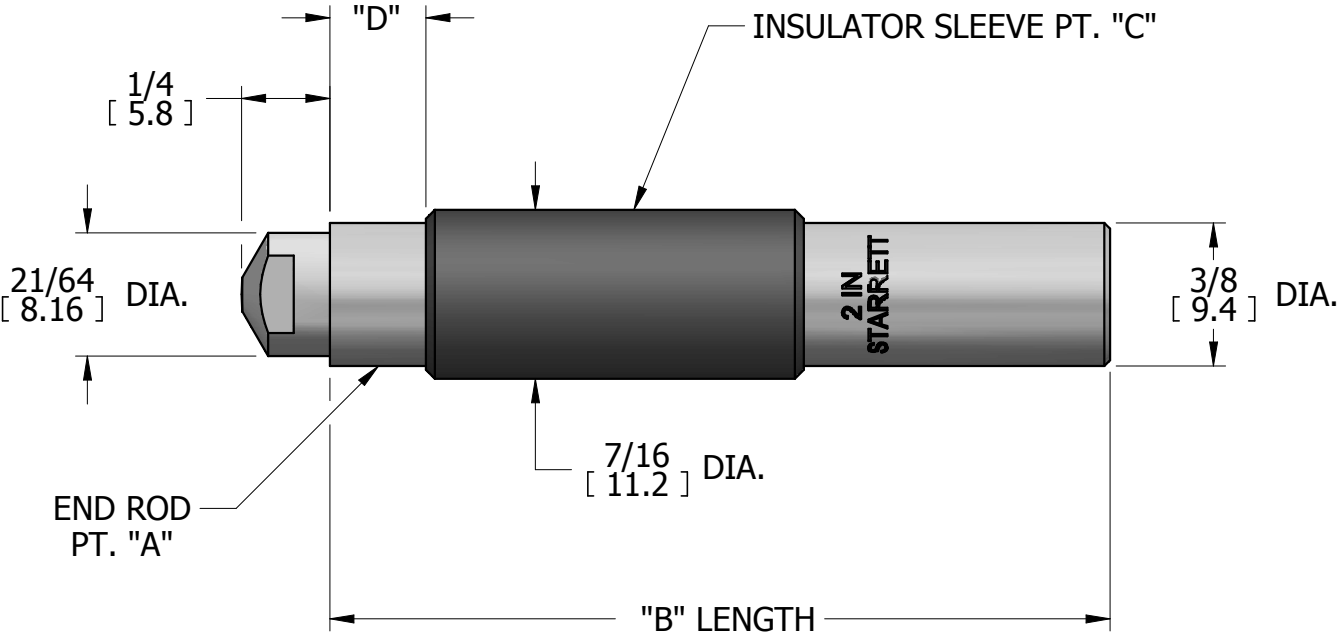

"A"	"B"	"C"	"D"	QTY
07346-2	1"	N/A	N/A	1 EA.
07346-4	2"	24633-0	1/4"	1 EA.
07358-7	3"	24635-0	1/4"	1 EA.
07358-9	6"	24635-0	1/2"	1 EA.
09948-8	8"	24635-0	1/2"	1 EA.
09948-9	9"	24635-0	1/2"	1 EA.
09948-10	10"	24635-0	1/2"	1 EA.

REV	DESCRIPTION	DATE	BY

DRSMB

CHK

DATE10/29/15

ELECTRONIC INSIDE
MICROMETER W/OUTPUT

THE L.S. STARRETT CO.
ATHOL, MASS.